

# Dupline® Master Channel Generator Types G 3800 0015, G 3800 1015

CARLO GAVAZZI



- Programmable channel generator
- Option for built-in GSM Modem for monitoring and control via SMS
- User-friendly configuration via Windows 98/2000/NT/XP software
- Real-time, timer and logic functions
- Analog set-point control and monitoring
- Light and Rollerblind control functions
- Alarm Monitoring
- 2 x RS232 ports for configuration and Dupline data read/write
- 1 x RS485 port for networking of up to 32 Master Generators
- Modbus-RTU protocol
- Built-in software driver for external radio modem
- 4 digital inputs / 4 digital outputs on-board
- H8-housing for DIN-rail mounting (EN50022)
- AC or DC power supply

## Product Description

Programmable channel generator with built-in dedicated intelligent functions for light and roller blind control, alarm monitoring and analog set-point control. In addition to that, there is realtime-, timer- and logic- functions. Programming is easily performed through Windows-based configuration software. An optional built-in GSM modem

can be used for monitoring and control of Dupline signals via SMS. Up to 32 Master generators can be networked as slaves in a RS485 network using the Modbus protocol. The unit has 4 digital inputs and 4 digital outputs on-board, and it is possible to create links to other Dupline networks via external Radio Modem.

## Ordering Key

**G 3800 1015 230**

Type: Dupline® \_\_\_\_\_  
H8-housing \_\_\_\_\_  
GSM phone \_\_\_\_\_  
Master channel generator \_\_\_\_\_  
Supply \_\_\_\_\_

## Type Selection

Supply	Ordering no.	Ordering no. w. GSM telephone
115/230 VAC	<b>G 3800 0015 230</b>	<b>G 3800 1015 230</b>
10-30 VDC	<b>G 3800 0015 800</b>	<b>G 3800 1015 800</b>

## Input/Output Specifications

<b>Serial Port</b> COM 1 COM 2	RS 232 115 kBaud 9600 Baud, adjustable	<b>Digital outputs</b> Function Output voltage $V_{DD}$ Output current Output voltage drop Off-state leakage current Short-circuit protection Built-in protective diodes Dielectric voltage Output - Dupline® Output - Input Inductive loads	4 PNP transistors Programmable $\leq 35$ VDC $\leq 100$ mA $\leq 2$ V $\leq 100$ $\mu$ A None None $\geq 4$ kVAC (rms) 200 V External noise suppression required
<b>Data format</b> COM 1, COM 2	8 bit No parity 1 stop bit 9-pole female SUB-D	<b>Inputs</b> Digital Voltage  Current Dielectric voltage Input - Dupline®	6 - 30 VDC ON > 5.5 V OFF < 1.5 V $\leq 6$ mA $\geq 4$ kVAC
Pin assignment	TxD Pin 2 RxD Pin 3 GND Pin 5	<b>GSM Modem</b> Siemens cellular engine Dual Band Output power  Antenna connector	TC35 EGSM900 and GSM1800 Class 4 (2 W) EGSM900 Class 1 (1 W) GSM1800 FME
Dielectric voltage Com.port - Dupline® Protocol	$\geq 2$ kVAC (rms) Modbus-RTU	<sup>*)</sup> V+ and GND may be used as supply for digital I/O's, if RS 485 is not used.	
<b>RS 485</b>	Termination Fs-B Fs-A + (B) - (A) GND V+	Pin 27 When in use, connect to pin 31 Pin 28 When in use, connect to pin 30 Pin 29 When in use, connect to pin 31 Pin 30 Pin 31 Pin 32 Pin 33 <sup>*)</sup> Modbus-RTU	
<b>Dupline® Output</b> Output voltage Current Short-circuit protection Sequence time 32 channels 128 channels	Dupline® carrier 8.2 V < 130 mA Yes  38.6 ms 132.3 ms		



## Supply Specifications

<b>Power supply</b> AC-Types	Overvoltage cat. III (IEC 60664)
Rated operational voltage through term. 21 & 24 jumper term. 22 & 23	230 VAC ± 15% (IEC 60038)
Power on term. 21 & 23	
Neutral on term. 22 & 24	115 VAC ± 15% (IEC 60038)
Frequency	45 to 65 Hz
Rated operational power	Typ. 7 VA/3 W
Power dissipation	
G 38000015	≤ 6 W
G 38001015	≤ 7 W
Rated impulse withstand voltage	
230 V	4 kV
115 V	2.5 kV
Dielectric voltage	
Supply - Dupline®	≥ 4 kVAC (rms)
Supply - Output	≥ 4 kVAC (rms)
Supply - Input	≥ 4 kVAC (rms)
Supply - Com. ports	≥ 4 kVAC (rms)
Heat dissipation	4 W
<b>Power supply</b> DC-Types	Overvoltage cat. III (IEC 60664)
Rated operational voltage through term. 21 & 22	10 to 30 VDC
AC monitor terminal 24 and 25	- 50 Hz for synchronizing the clock - in case of voltage break (AC) the log will automatically update itself until 10 mSec before the loss of current
Reverse polarity protection	Yes
Rated operational power	6 W
Power dissipation	
G 38000015	≤ 6 W


## Supply Specifications

G 38001015	≤ 7 W
Inrush current	1 A
Rated impulse withstand volt.	800 V
Dielectric voltage	
Supply - Dupline®	500 V
Supply - Output	200 V

## General Specifications

<b>Real-time clock</b>	
Accuracy	Better than ± 1 minute/month
Internal back-up time	Typ. 48 hours
<b>Power ON delay</b>	< 2.5 s
<b>Indication for</b>	
Supply ON	LED, green
ON Line	LED, yellow
COM 1	LED, red
COM 2	LED, red
RS 485	LED, red
GSM	LED, red
<b>Environment</b>	
Degree of protection	IP 20
Pollution degree	3 (IEC 60664)
Operating temperature	0° to +50°C (+32° to +122°F)
Storage temperature	-20° to +85°C (-4° to +185°F)
<b>Humidity (non-condensing)</b>	20 to 80% RH
<b>Mechanical resistance</b>	
Shock	15 G (11 ms)
Vibration	2 G (6 to 55 Hz)
<b>Dimensions</b>	
<b>Material</b> (see "Technical Information")	H8-housing
<b>Weight</b>	640 g

## Wiring Diagrams

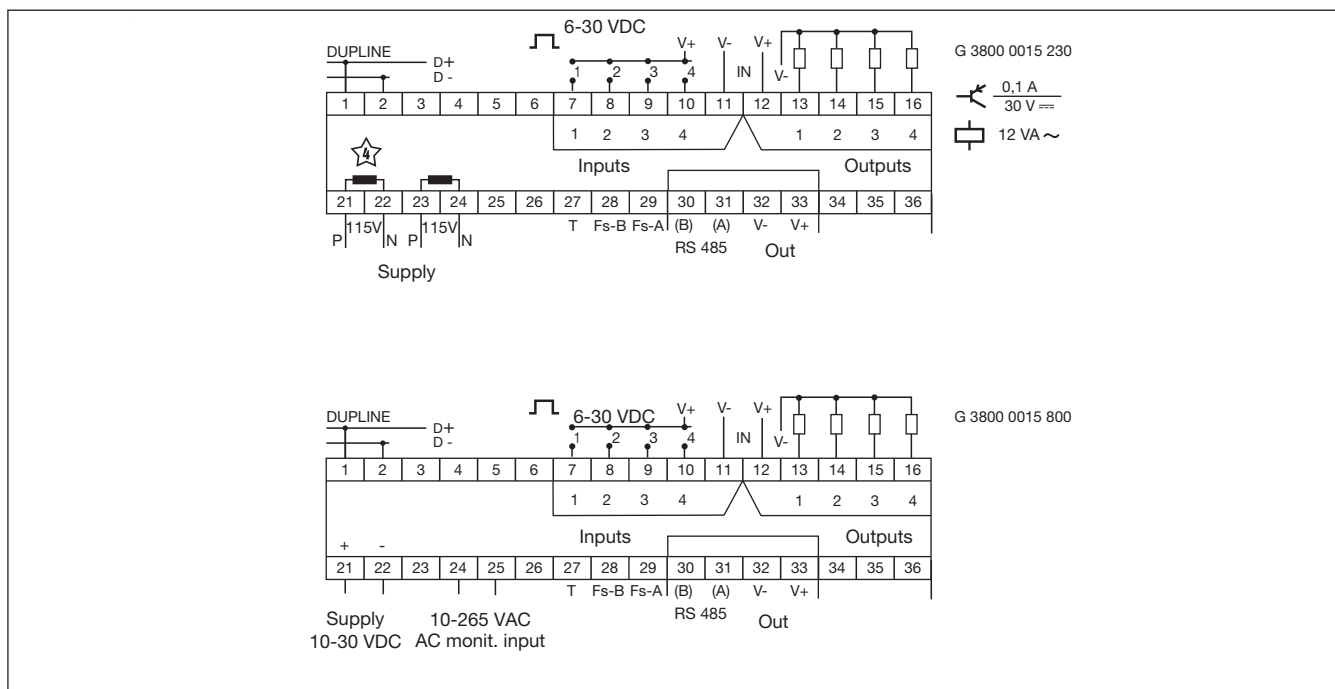

## Mode of Operation

### Intelligent functions

The G3800X015 Master Generator is a programmable channel generator which is particularly well suited for building automation applications due to the dedicated intelligent functions for lighting control, roller blind control, temperature control and alarm monitoring. In addition to that, the unit can be configured to perform real-time, logic and timer functions. The Windows-based configuration software is extremely easy to use due to the pre-programmed functions.

### Master Generator configuration

The Master Generator is as default configured to operate as a standard channel generator without intelligent functions. In order to make use of the intelligent functions, the Master Generator must be configured by means of the user-friendly Windows-based configuration software. This is included in the package and has to be installed on a Win 95/98/2000/NT/XP PC. When the configuration is completed, the configuration is downloaded into the Master Generator via COM1 (RS232 port). The configuration can be saved on a file, and it is also possible to upload the configuration from a Master Generator.

### GSM Modem Option

The G38001015 Master Generator has a built-in GSM Modem which enables monitoring and control of Dupline signals via SMS messages to/from mobile GSM telephones. There are 3 different ways to use SMS messaging:

- The Master Generator can be programmed to send out event-based SMS messages. The event can be a channel switching ON or OFF, or it can be an analog signal crossing a set-point.
- Requests for status of digital or analog data can be sent and answered via SMS messages
- Status of digital channels can be controlled by sending commands via SMS messages

In order to make use of the GSM modem, the following is required:

- A SIM-card with the pin-code 9090 needs to be inserted into the slot in the front of G38001015. The SIM-card must be a 3V type.
- A GSM antenna needs to be connected to the FME connector on G38001015. If the unit is installed in a metal enclosure, the antenna must be installed outside the enclosure and connected to the Master Generator via a cable (an antenna of this type is available as accessory).

An LED in the front of G38001015 indicates the status of the GSM modem. By emitting different blink patterns, the LED indicates "connecting", "SIM-card missing", "No network found", "No response from modem", "SMS sent" and "SMS received".

### RS232 ports

The Master Generator is provided with two RS232 ports (COM1 and COM2) which both can be used by PC's/PLC's for read/write of Dupline data using the Modbus-RTU protocol. COM1 is also used for download and upload of configuration files (created by the Master Generator configuration software) and for firmware upgrades. If the option for an external radio modem is desired, it needs to be connected to COM2. COM1 has a fixed baudrate of 115 kBaud, while the baudrate of COM2 is adjustable.

### RS485 port

The RS485 port enables networking of up to 32 Master Generators operating as Modbus-RTU slaves. This makes it possible for a PC or PLC operating as RS485 Modbus-RTU Master to read/write data from any of the 32 Master Generators. Each unit must be assigned a device address via the configuration software. In total, the RS485 network makes up to 4096 Dupline I/O points accessible from the PC or PLC. Find below a RS485 networking diagram.

### Modbus-RTU protocol

Using the Modbus-RTU commands 2 and 3 through COM1,

COM2 or RS485 makes it possible to read any type of Dupline data (digital, analog, multiplexed analog or counter data). The status of digital and multiplexed analog data and reset of counter can be controlled via the commands 5, 6 and 16. See manual for memory map information.

### Software

The Dupline Data Access software package (type no. DUP-DATACC) has been developed specifically for the Master Generator. It contains two software tools that provide easy access from a PC to Dupline digital, analog and counter data via one of the RS232 or RS485 ports. The DDE-driver provides a Dynamic Data Exchange interface, which can be used from applications that support client side DDE such as Microsoft EXCEL. Getting Dupline data into an EXCEL spreadsheet is a simple copy-and-paste operation. The Dupline ActiveX driver provides an ActiveX interface, which is a Microsoft standard for communication between two products. The Dupline ActiveX driver can be used from any development tool that supports client side ActiveX such as Microsoft Visual Basic, Delphi and Borland C++ builder.

The Dupline Data Access package can be used on single Master Generators as well as Master Generator networks.

### Radio Modem driver

The Master Generator has a built-in driver for control of an external Radio Modem, which can be used to create wireless links where no cable is available in parts of an installation. One Master Generator must be defined as the central MGEN and up to 32 Master Generators can be defined as remote MGEN's. The central MGEN is continuously polling and updating the Dupline data from all remote MGEN's via the radio modem network, and in this way it makes the entire system operate as one big Dupline network. Apart from increased reaction time (depending on the number of remote MGEN's), the system will operate as if it was one Mas-

ter Generator connected to all the I/O-modules with cable. The Master Generator supports the Radio Modem type 2ASxE and all 3AS types from the Finnish manufacturer SATEL ([www.satel.fi](http://www.satel.fi)).

Find below an application diagram for the Radio Modem option.


Note: Analog modules cannot be used with Radio Modems.

### On-board I/O


The Master Generator has 4 digital inputs and 4 digital outputs on-board. These have been implemented to reduce the cost of remote stations with only a few signals (e.g. in connection with an SMS alarm system or radio modem remote stations). The onboard I/O's are used via the logic functions of the Master Generator, where they can be assigned to specific channel addresses.



## Pin Assignment, COM1, COM2

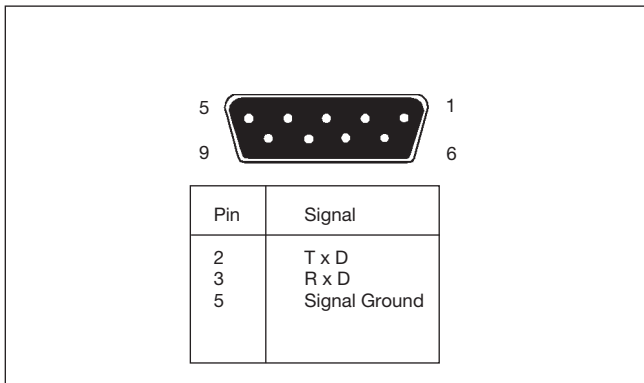

## RS 232 Cable

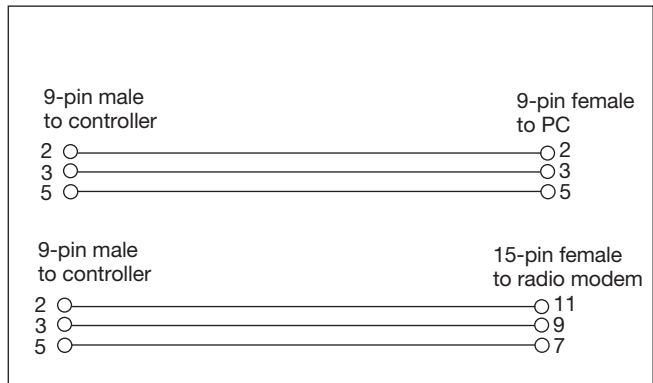

## Wiring Diagram

**Example of a complete wiring diagram for a system with 3 Master Generators connected in an RS485 network.**

### The Cable

The RS485 communication cable is a shielded, twisted pair cable. The cable must be installed to pass close by each mode. The maximum length of a single cable run is 1200 m.


The cable must be terminated at each end.

The termination resistor is connected to terminal 30 (B) and terminal 27 internally. Therefore pin 27 needs to be connected to pin 31 (A) in both of the cable endings in order to make the terminations effective.


The fail-safe resistors shall only be used in one cable end. By connecting pin 31 (A) to pin 29, and by connecting pin 30 (B) to pin 28, the fail-safe resistors are made effective.

### Cable isolation


The communication cable must not be run in cable trays carrying power wiring nor in close proximity to power wiring.

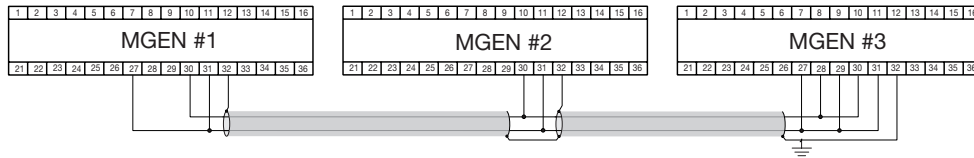


## Radio Modem Application

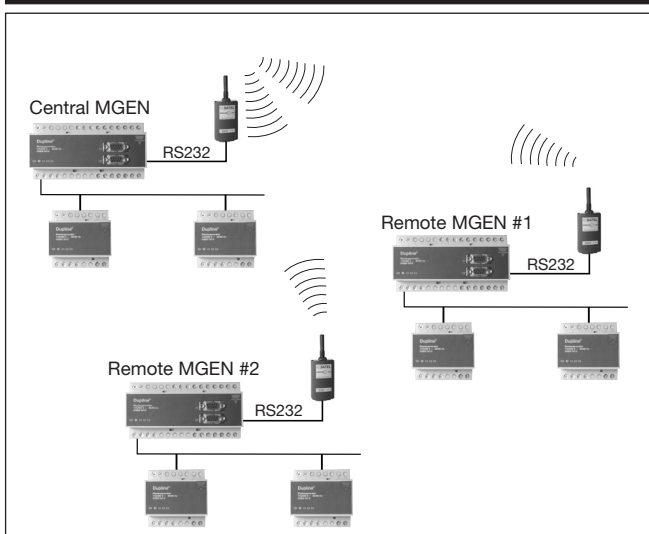

## Networking

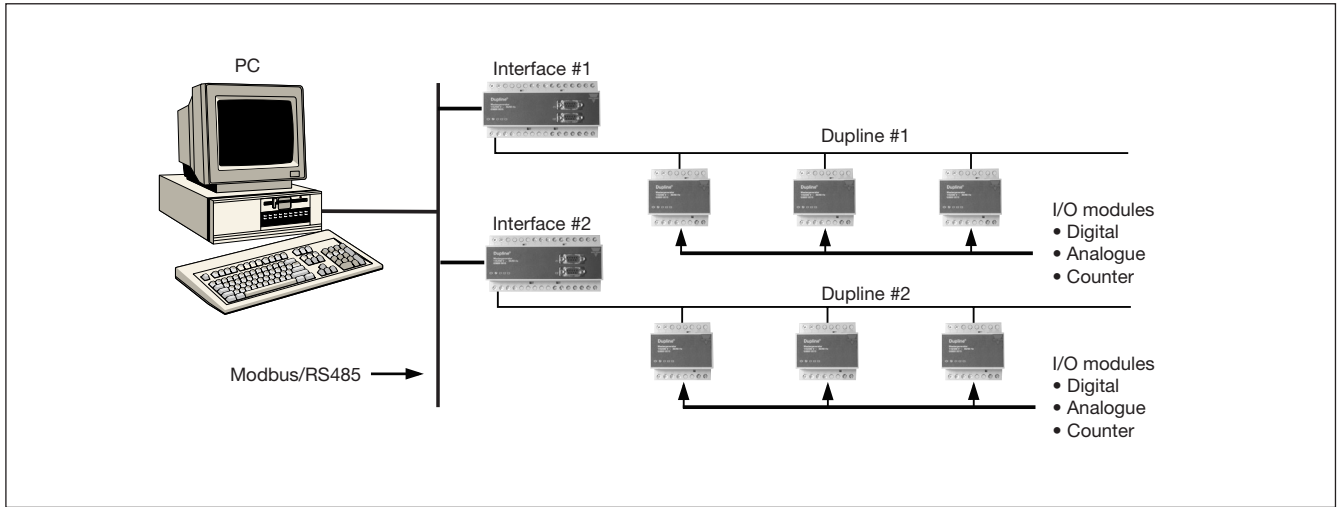

## Dimensions (mm)

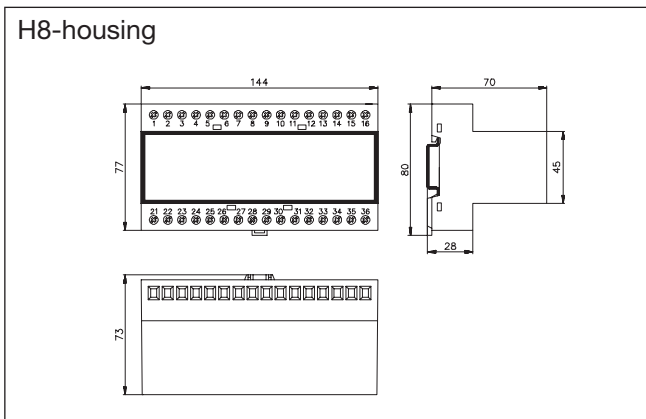

## Scope of Supply

- |                              |                     |
|------------------------------|---------------------|
| 1 x Master Channel Generator | G 3800 x015 xxx     |
| 1 x User manual              | MAN G 3800 0015 ENG |
| 1 x RS 232 cable             | RS 232-9 M/9 F      |
| 1 x Configuration software   | SW G 38xx15         |

## Accessories

- |                              |           |
|------------------------------|-----------|
| Dupline Data Access Software | DUPDATACC |
| GSM Antenna 900 MHz          | ANT1      |

